


NOTES:

- 1) Do not scale drawing.
- 2) Dimensions are in inches(mm).
- 3) LHR active pair shown. Preparation is typical for both hands.
- 4) Minimum door stile width: 4-1/2(114).
- 5) Prepare mounting holes when installing the device.
- 6) For other center clearances compensate locating dimensions as required.
- 7) For recommended door reinforcements see template 7400-0000. Unreinforced doors require SNB option to mount the hardware.
- 8) Holes for optional SNB: 9/32(7.00) dia., inside door face; 3/8(9.50) dia., outside door face.
- 9) Provide door stiffeners, as needed to prevent door collapse due to installation with power tools, door use, or abuse.
- 10) Device mount to hinge stile (not shown) requires holes location and preparation during device installation.
- 11) For trim preparation see appropriate trim template.
- 12) Cutout, thru inside door face, only required when active outside trim is used.

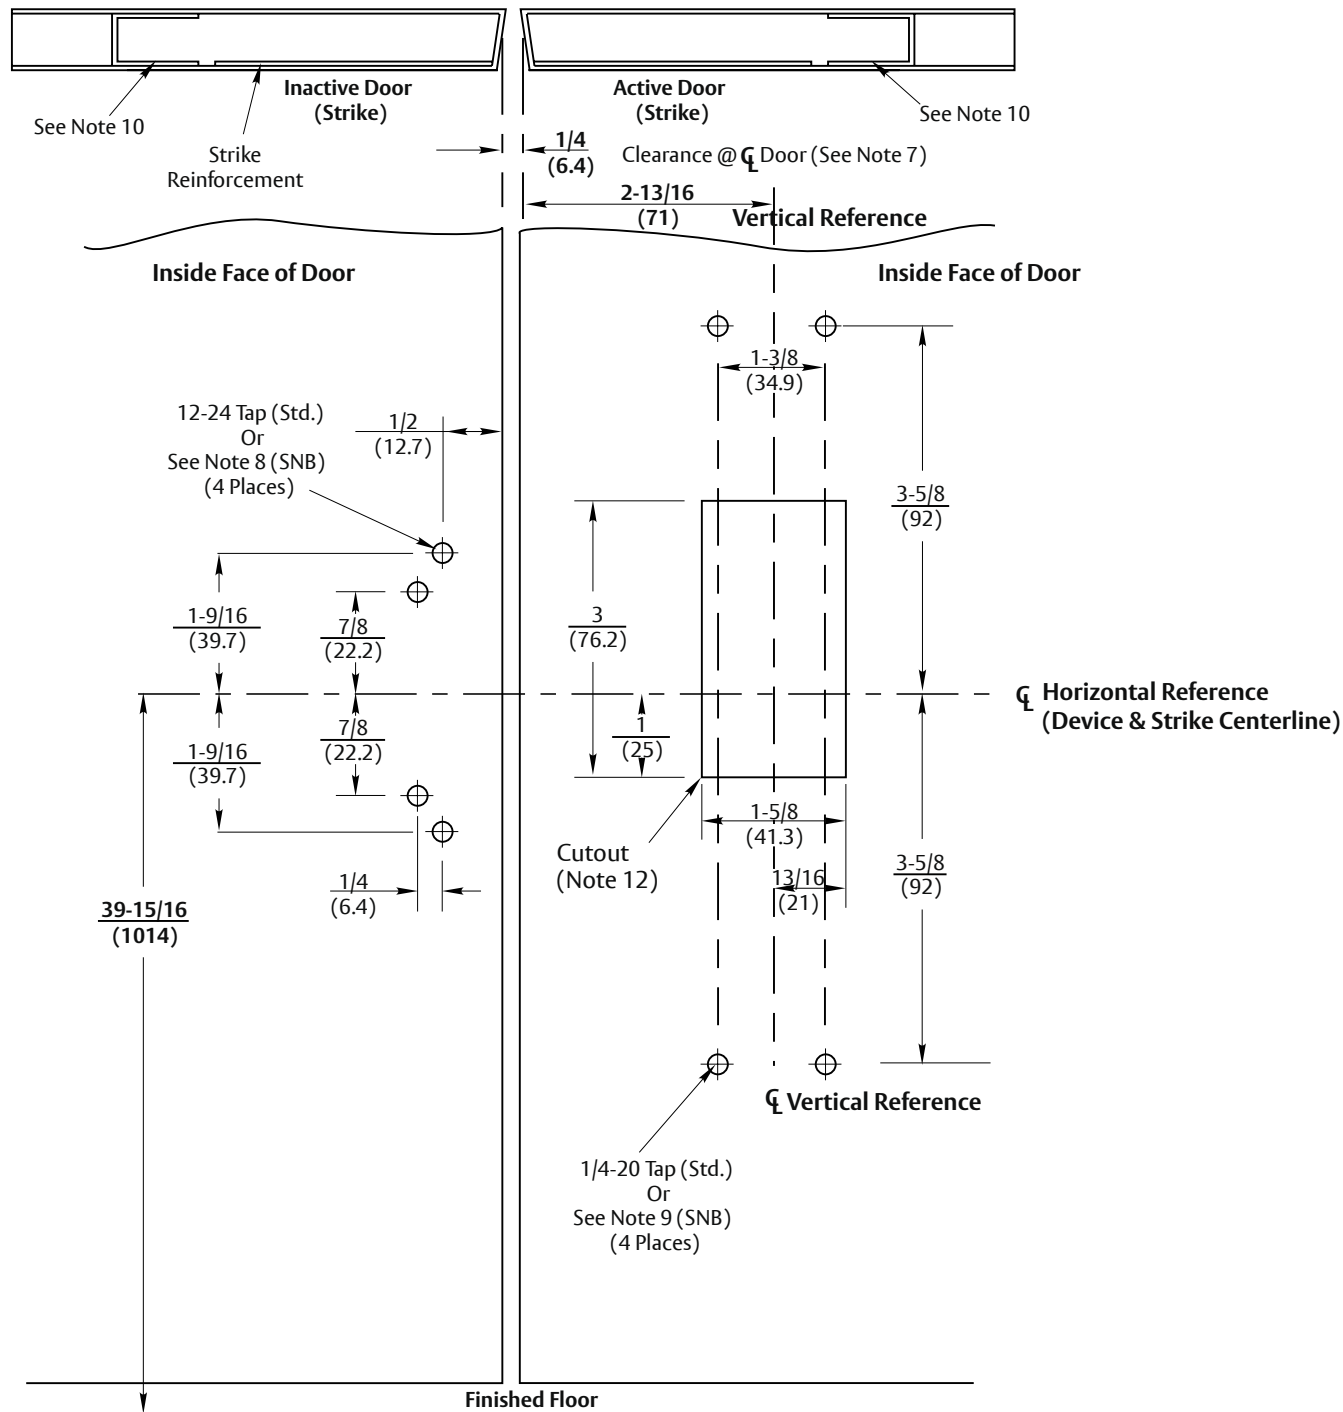

RESPONSIBILITY
 DOOR AND FRAME MANUFACTURERS ARE RESPONSIBLE FOR PROVIDING ADEQUATE CONSTRUCTION OR REINFORCEMENTS FOR PROPER INSTALLATION OF HARDWARE SHOWN. ALL ARCHITECTURAL BUILDERS HARDWARE MUST BE INSTALLED ON PROPERLY REINFORCED DOORS AND FRAMES, REGARDLESS OF TYPE, MATERIAL, OR METHOD OF CONSTRUCTION.

1500 Rim Panic Devices with Optional 701 Strike
 Application For Pair Opening of Metal Beveled Doors without Mullion (Not for Fire Labeled Devices)
Contact us for support at 1-855-557-5078.

ASSA ABLOY

SUPERSEDES	8/99	DO NOT SCALE DRAWING
TEMPLATE NUMBER	7415-0001	DATE 12-23