


Opening		Dim. A	Dim. B	Dim. C
Hold Open★	Stop			
85°	90°	10-5/8 (270)	8-5/8 (219)	9-5/8 (244)
90°	95°	9-7/8 (251)	8 (203)	9 (228.5)
95°	100°	9-3/8 (238)	7-1/2 (191)	8-1/2 (216)
100°	105°	9 (228.5)	7-1/8 (181)	8-1/8 (206)
105°	110°	8-5/8 (219)	6-3/4 (171)	7-3/4 (197)
110°	115°	8-1/4 (209.5)	6-3/8 (162)	7-3/8 (187)

★ Door must be free to swing 5° beyond hold- open position.

Notes:

- Do not scale drawing.
- All dimensions shown in inches.
- Left hand door shown.
- Hollow metal doors require channel or box type reinforcement when thru-bolt mount is specified.
- Sex-bolts may be required for wood or plastic faced fire door mounting.
- Minimum thickness recommended for reinforcements in hollow metal doors and frames: .1046" (2.66mm).
- UNI-150 Series have a hold open arm feature and are not permitted to be used on fire door assemblies.

Top View Typical Installation

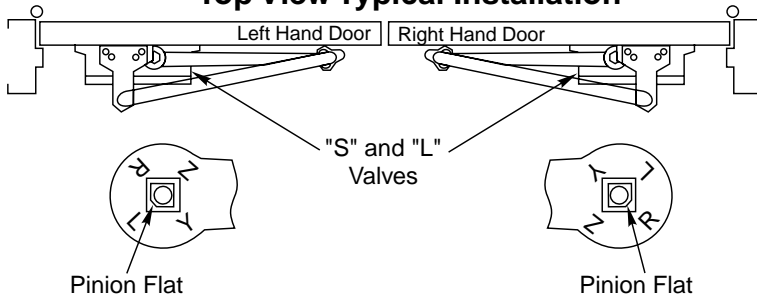

Fastener	Door or Frame	Drill
SNB	hollow metal	9/32" (7.00mm.) thru 3/8" (9.50mm.) door face opposite to closer
	aluminum or wood	3/8" (9.50mm.) thru

UNI-50 Series Closer – Non Hold Open/Stop Arm
UNI-150 Series Closer – Hold Open/Stop Arm
 Door Closer Sizes 1, 1BF, 2, 3, 4, 5, or 6
 Flush Transom Parallel Arm Application with 589L Bracket
 Doors 28" – 32" (0.70 - 0.80m) Wide

Parallel Arm Installation Template —
Flush Partitions
Stop Only or Hold Open Unitrol
Backcheck or Delayed Action Door Closer
With or Without 214 Drop Plate

Yale®
 Yale Commercial Locks and Hardware
 www.yalecommercial.com
 Template Number **7350-2360** Date **6-99**