


For Notes & Frame Prep
See Sheet 2

DOOR SPECIFICATION

Door Thickness: 1-3/4" (45mm) Min.

Door Construction: Wood or composite door with fire or panic rating as required. Door may require metal channel edge which may alter backset dimensions. Consult door manufacturers listings.

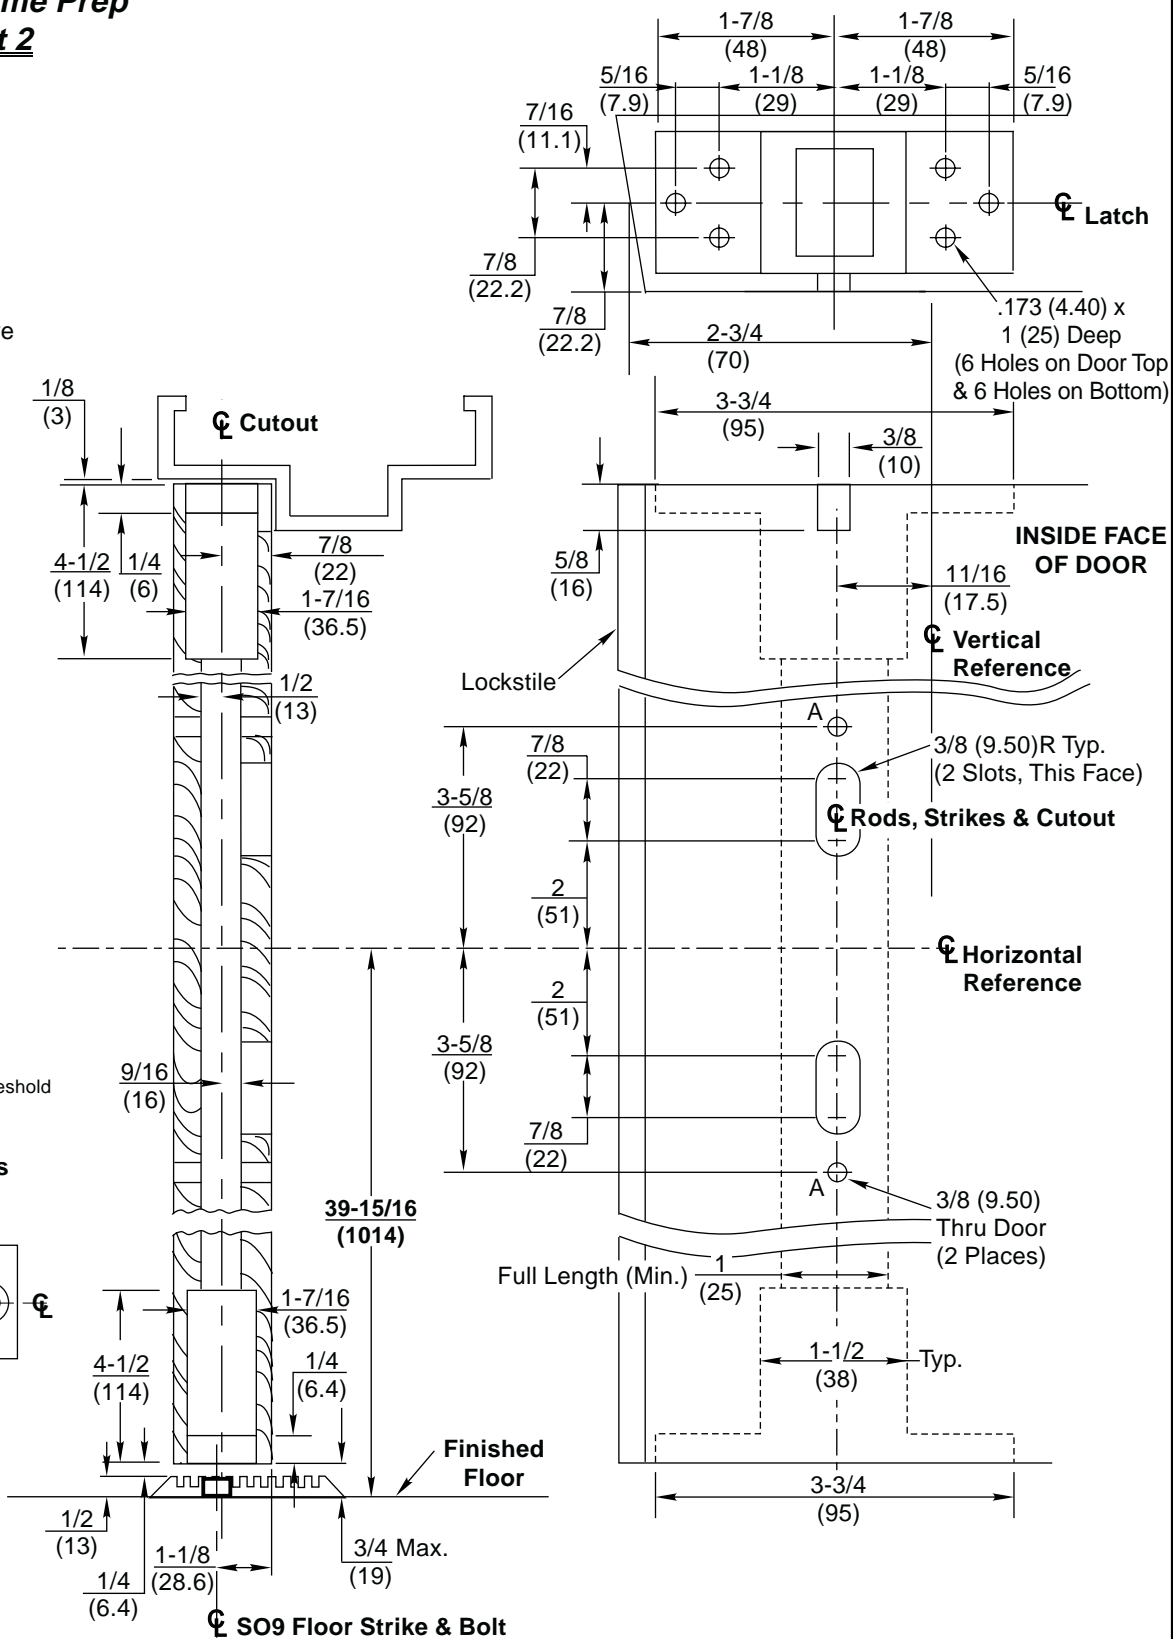

ED5860 & ED5860B Series
Concealed Vertical Rod Exit Devices
 Application for Wood Door & Metal Frame
 with 1/2" Threshold & Optional SO9 Floor Strike





www.corbinrusswin.com

SUPERSEDES T30906-2 DO NOT SCALE DRAWING

TEMPLATE NO. T30906-3 SHEET 1 of 2 DATE 1-02

681F77 Top Strike Preparation (See Note 6)

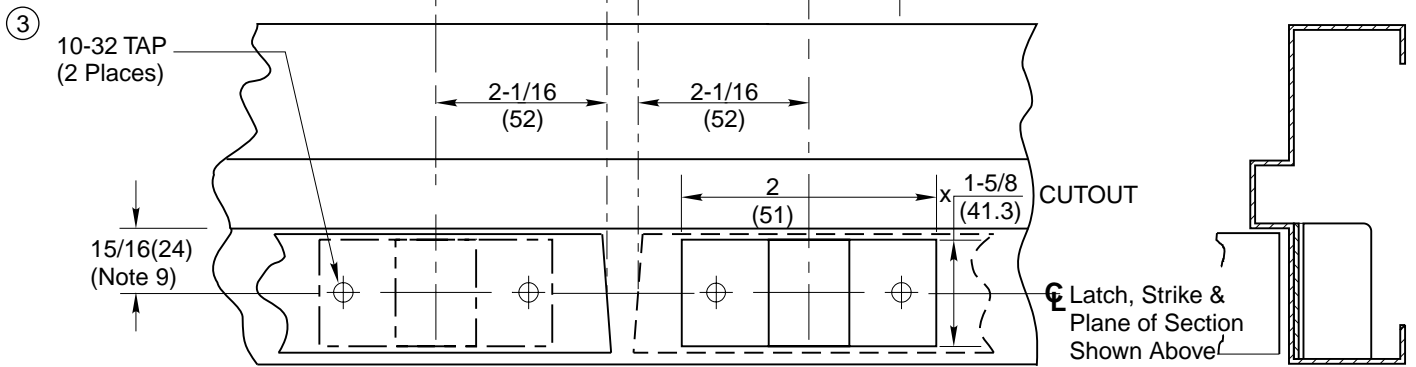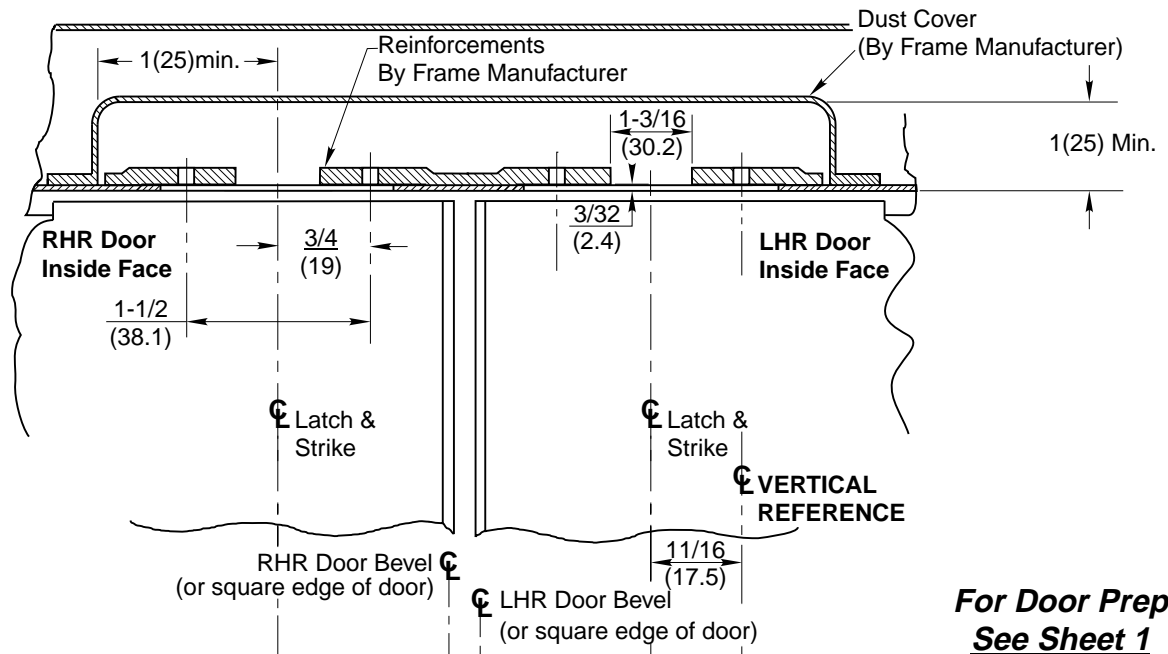

Notes:

1. Do not scale drawing.
2. Dimensions are in inches (mm).
3. Preparation is typical for both hands.
4. Minimum door stile width: 4-1/2 (114).
5. Prepare mounting holes when installing the device.
6. Drawing shows elevation (frame bisected on strike center), bottom view looking up and side view.
7. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
8. This template does not cover devices without bottom rod (M55 Option).
9. Door located in frame for door silencers. If not used, compensate this dimension to seat the door against the stop without rattle.
10. Device mount to hinge stile (not shown) requires hole location and preparation during device installation. Door structural requirements are similar for both stiles.
11. For outside trim preparation see appropriate trim template.
12. For electrical devices (suffixes M91, M92, M93, M94, M97) also see template T30890.
13. Bottom bolt should retract to 5/32 (4.0) above floor strike. Floor coverings in the door path must be laid accordingly.

ED5860 & ED5860B Series
Concealed Vertical Rod Exit Devices
 Application for Wood Door & Metal Frame
 with 1/2" Threshold & Optional SO9 Floor Strike



www.corbinrusswin.com

SUPERSEDES	T30906-2	DO NOT SCALE DRAWING
TEMPLATE NO.	T30906-3	SHEET 2 of 2 DATE 1-02