


MEL Exit Device, 1 Single Door, AL125UL

NOTES:

- 1) Verify that each component requiring or supplying power has been configured for proper system voltage before applying power.
- 2) All wires to be 18 awg 100' max unless otherwise noted on drawing. Refer to manufacturers instructions for proper wire gauge on any power supply, electric device or electrified lock hardware. Manufacturers requirements take precedence.
- 3) All line voltage power to be I/A/W local electrical code.
- 4) All low voltage wires to be stranded copper unless superseded by local electrical code or electric device manufacturer.

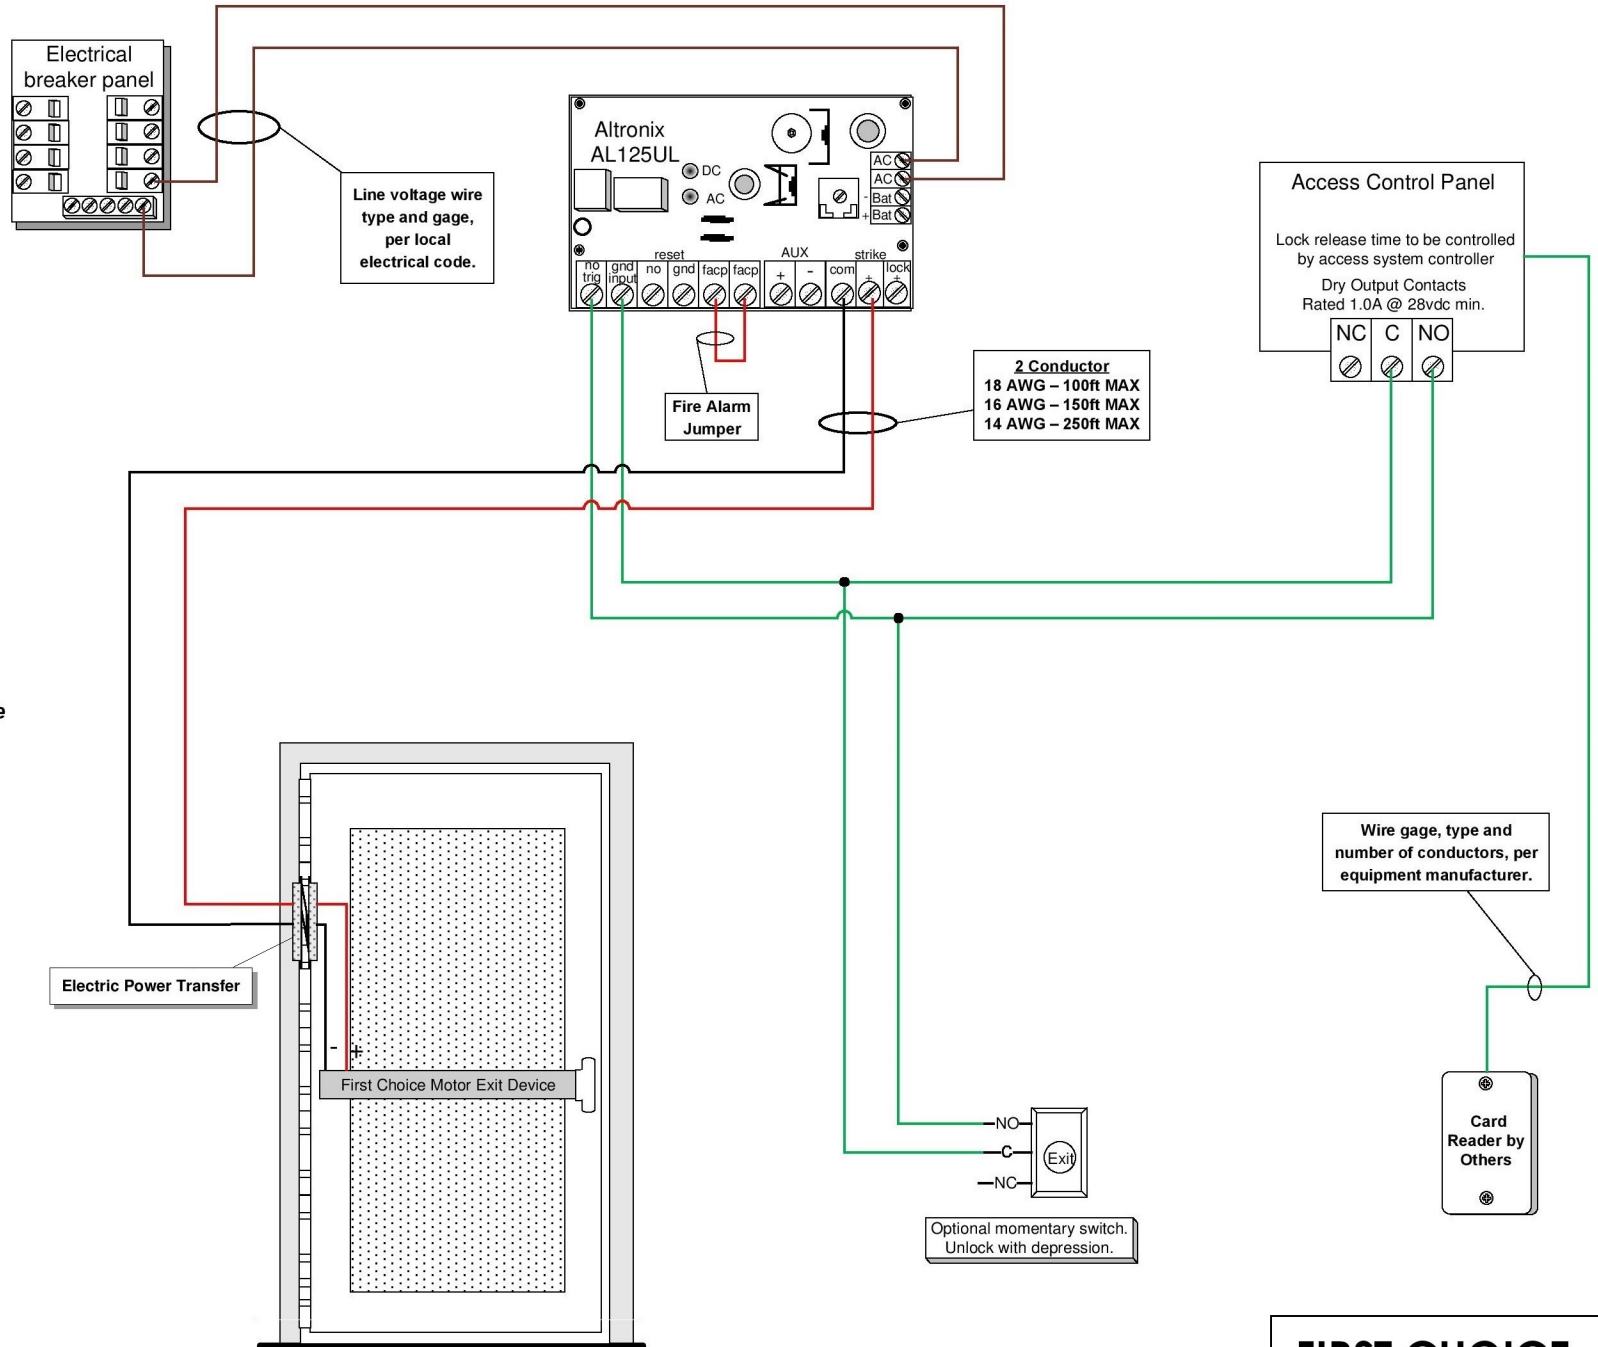


POWER TRANSFERS

NOTE:

Optional power transfers are available. Please note variations in wire size and maximum run length for these options.

- 18 AWG - 75 ft max
- 16 AWG - 125 ft max
- 14 AWG - 200 ft max



NOTE:
Make certain to maintain consistent wire color across the transfer.

Function Statement:

- From exterior - locked condition:** Access by presenting valid card to unlock active leaf.
- From exterior - unlocked condition:** Doors to remain locked unless active leaf held unlocked by access control system.
- From interior - locked condition:** Free egress at all times by means of exit device.
- From interior - unlocked condition:** Free egress at all times by means of exit device.

FIRST CHOICE
BUILDING PRODUCTS

REVISED: 2/25/2015