


**NOTES:**

- 1) Verify that each component requiring or supplying power has been configured for proper system voltage before applying power.
- 2) All wires to be 18 awg 100' max unless otherwise noted on drawing. Refer to manufacturers instructions for proper wire gauge on any power supply, electric device or electrified lock hardware. Manufacturers requirements take precedence.
- 3) All line voltage power to be I/A/W local electrical code.
- 4) All low voltage wires to be stranded copper unless superseded by local electrical code or electric device manufacturer.
- 5) It is considered good electrical practice to run spare wires at any location that may be difficult to access after construction.

**FOR REFERENCE ONLY**

**This drawing is not a substitute for qualified field technicians. One hour of telephone support is available without charge.**

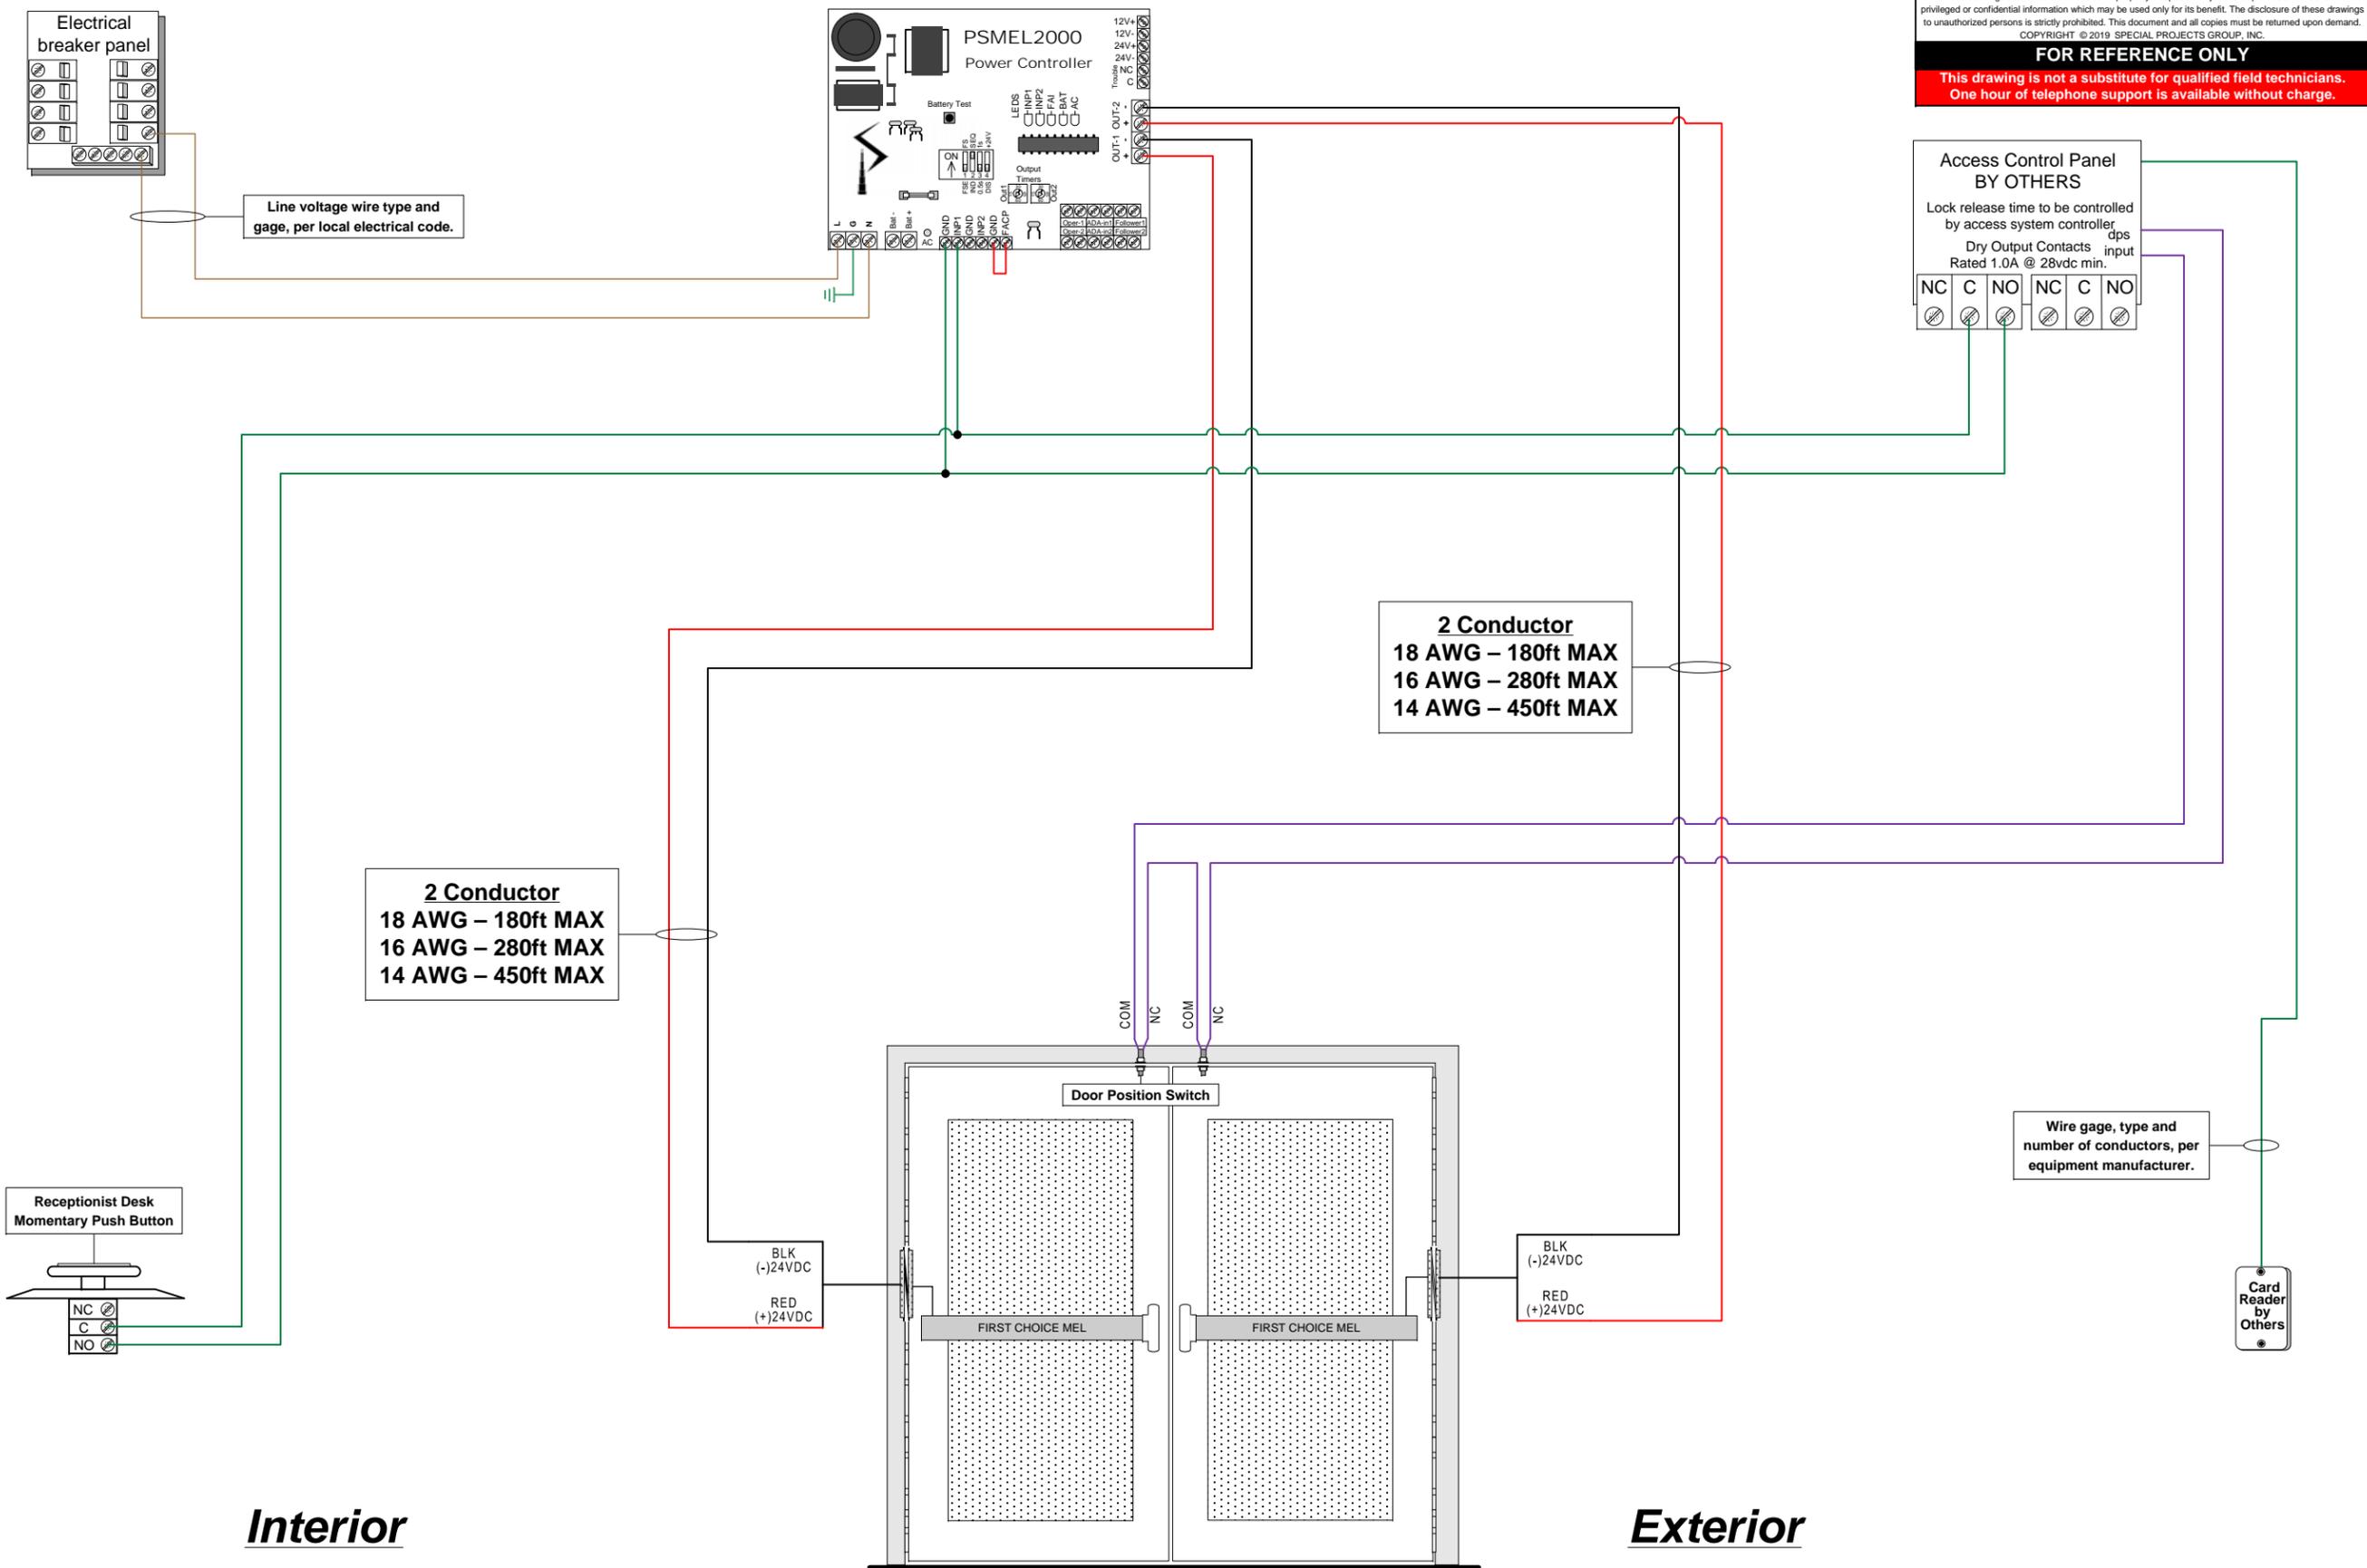

**Interior**

**Exterior**

**Function Statement:**

- From exterior - locked condition:** Access by presenting valid credential at reader interface to retract electric exit device latchbolts. Receptionist push button to unlock doors for visitor entry.
- From exterior - unlocked condition:** Doors to remain locked unless electric exit device held retracted by access control system or receptionist desk push button control.
- From interior - locked condition:** Free egress at all times by means of exit device.
- From interior - unlocked condition:** Free egress at all times by means of exit device.
- General:** Fail-secure electric latch retraction exit devices to remain locked during utility power-loss event.

Title: Pair MEL-PS-MEL-2000-pushbutton.vsd			Project: Example		
HWSET: Example		Door: EXT-1			
Date: 5/17/2019	Date Printed: 5/17/2019	Last Revised: 5/17/2019	10:35:38 AM		
Drawn By: Eric Norton	For: Special Projects Group	SO: n/a	Pg: 1 OF 1		